



RE implementation - PV installation program in University of Yangon

Dr Pho Kaung Rector (University of Yangon, Myanmar)

Hideaki OHGAKI (Kyoto University, Japan)

*Hla Toe (Pyay University/University of Yangon, Myanmar)

Dr Aye Aye Thant (University of Yangon, Myanmar)

Kyocera, and Earth RE Co. Ltd.

Outline

- **Collaborative research title:**
WP2: Energy and Environment - RE implementation
- PV installation program in University of Yangon
- National Electrification Plan (NEP)
- Brief of Myanmar Energy Policy
- UY PV project
- Future Plan

National Electrification Plan

Objective

The Myanmar National Electrification Plan aims to achieve 100% electrification by 2030.

Leading Ministries

- **MOEE Grid Extension (310 Mil USD)**
Dense areas (**Phase 1, 2 and 3**) require less MV per connection and will be connected first.
- **MOALI Off-grid (90 Mil USD)**
Remote communities areas (**Phase 4, 5**) have higher cost per connections and will be connected later.

- According to the Ministry of Energy and Electrical Power (MOEE), full electrification would require more than 7.2 million households to be connected over the next 16 years.

Township Map FY(2016 - 2017) NEP Project



Sagaing Region
Townships - 17
Villages - 151
Households - 9770

Chin State
Townships - 6
Villages - 290
Households - 11289

Rakhaing State
Townships - 17
Villages - 525
Households - 27471

Ayeyarwady Region
Townships - 13
Villages - 388
Households - 25324

Shan (N)State
Townships - 18
Villages - 543
Households - 20198

Shan (E)State
Townships - 9
Villages - 266
Households - 7400

Kayin State
Townships - 5
Villages - 143
Households - 11442

Tanintharyi Region
Townships - 9
Villages - 288
Households - 18649


Legend

NEP Township Point [94]


- Ayeyarwady [13]
- Chin [6]
- Kayin [5]
- Rakhine [17]
- Sagaing [17]
- Shan (East) [9]
- Shan (North) [18]
- Tanintharyi [9]

MyanmarStates+Regions [18]


- NEP Project [8]
- None [10]



- ❖ State/ Region - 7
- ❖ Township - 94
- ❖ Village - 2743
- ❖ Households - 145191

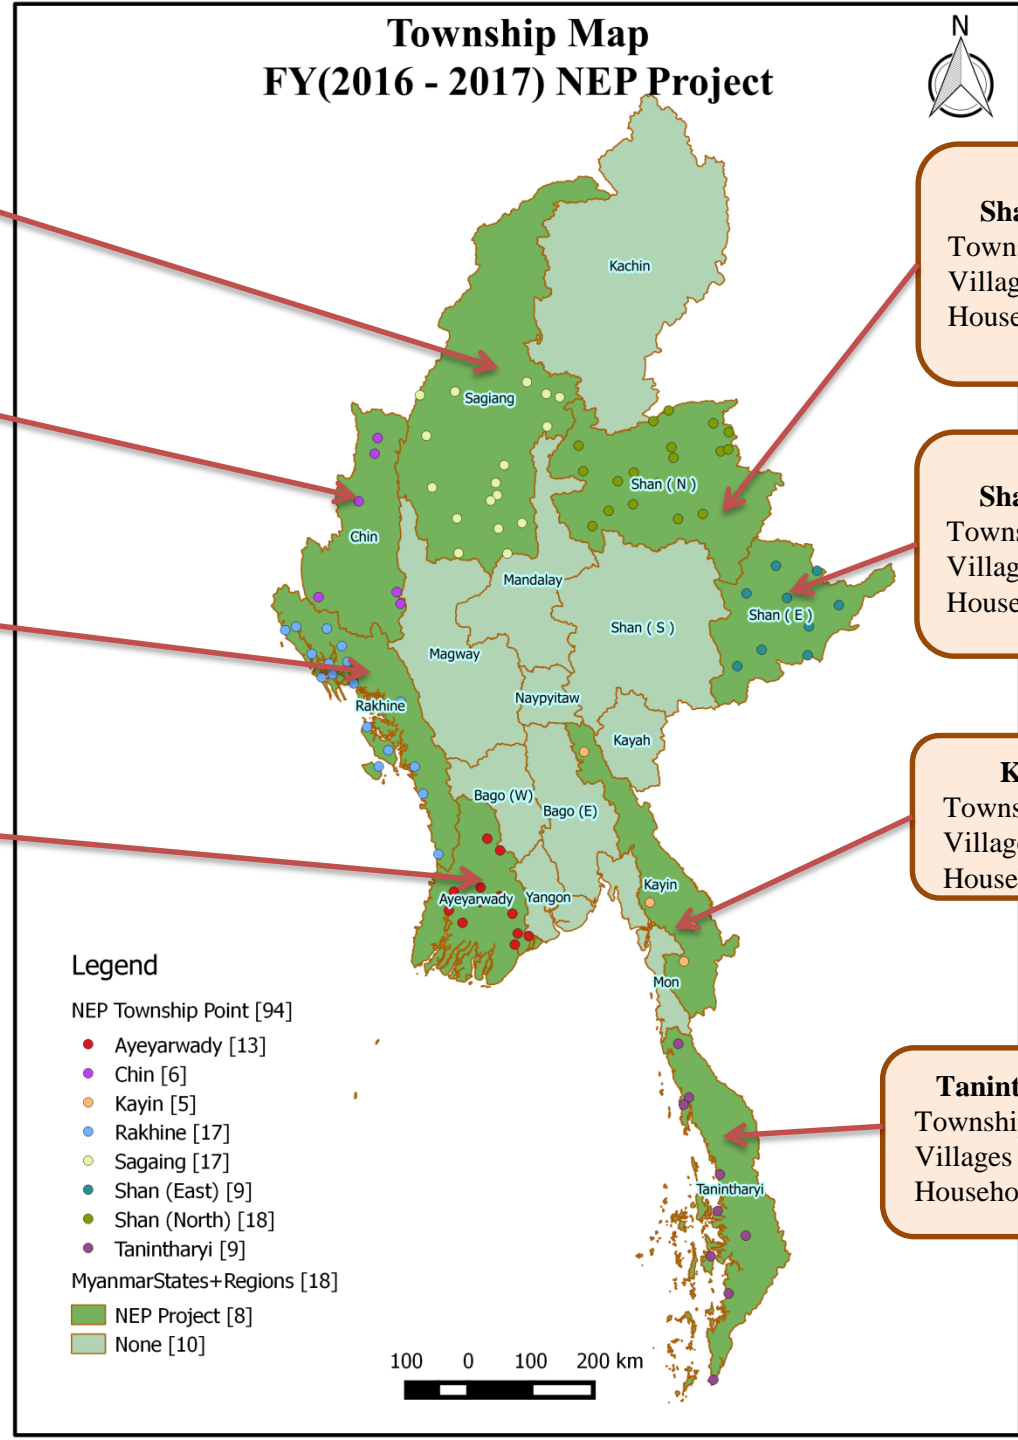

Current Electrified Villages

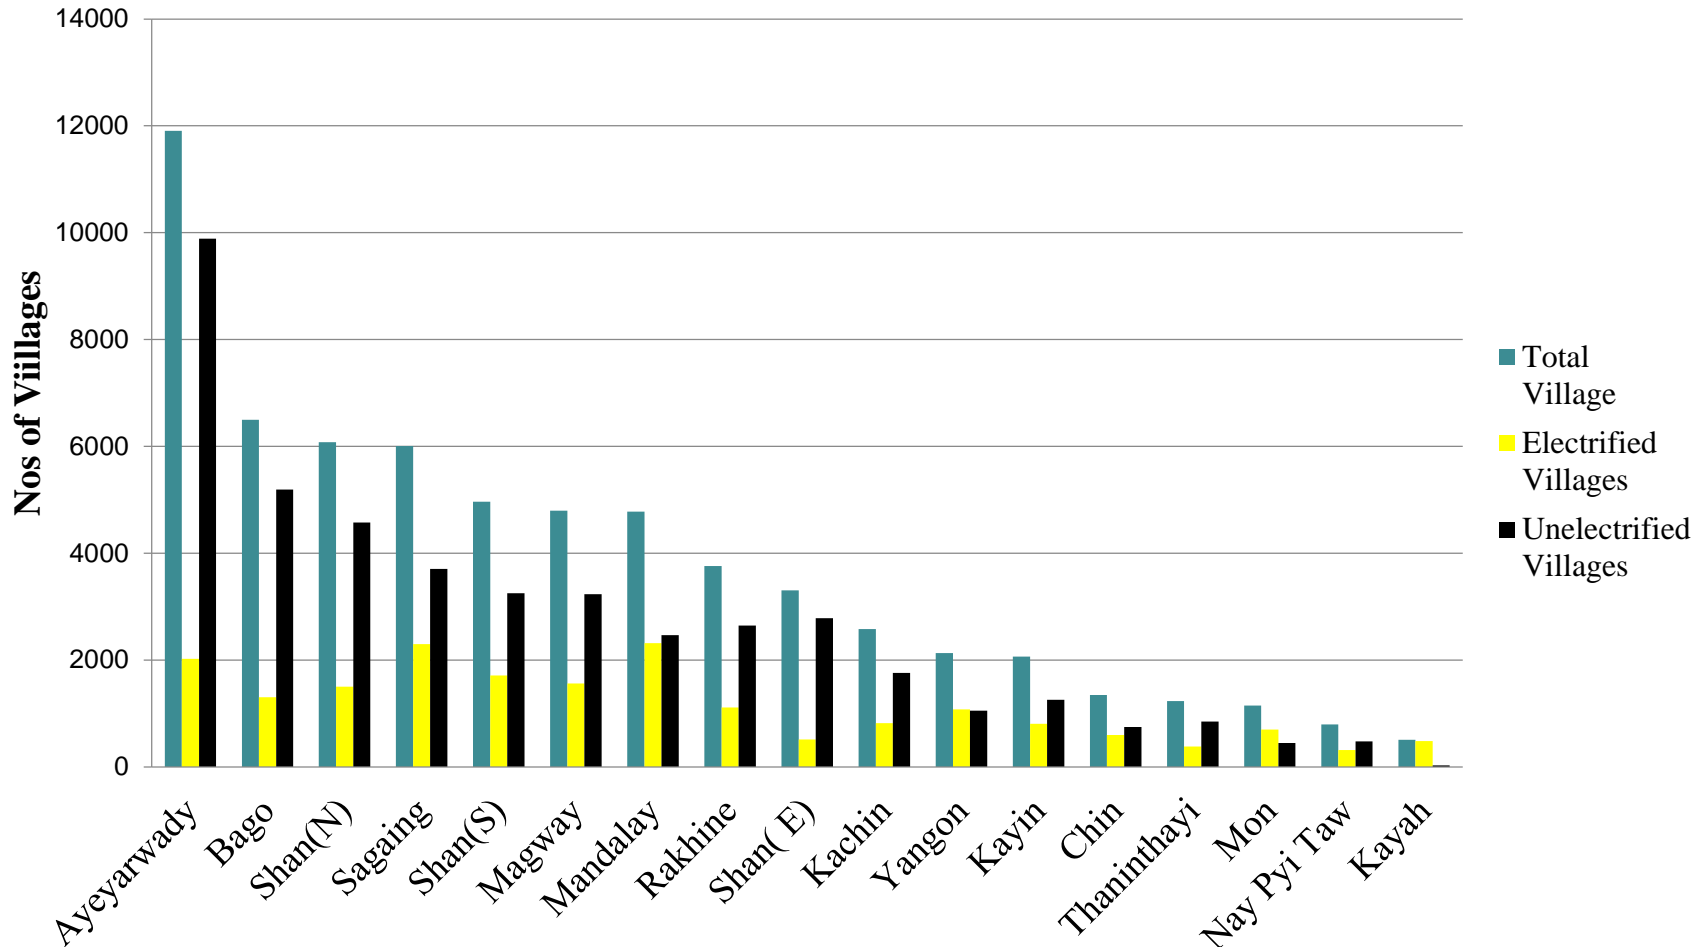


Total villages - 63899

Electrified villages - 20807

Unelectrified villages - 43092

Base on 70% electrified HH in Villages

Current Electrification System in Rural Area

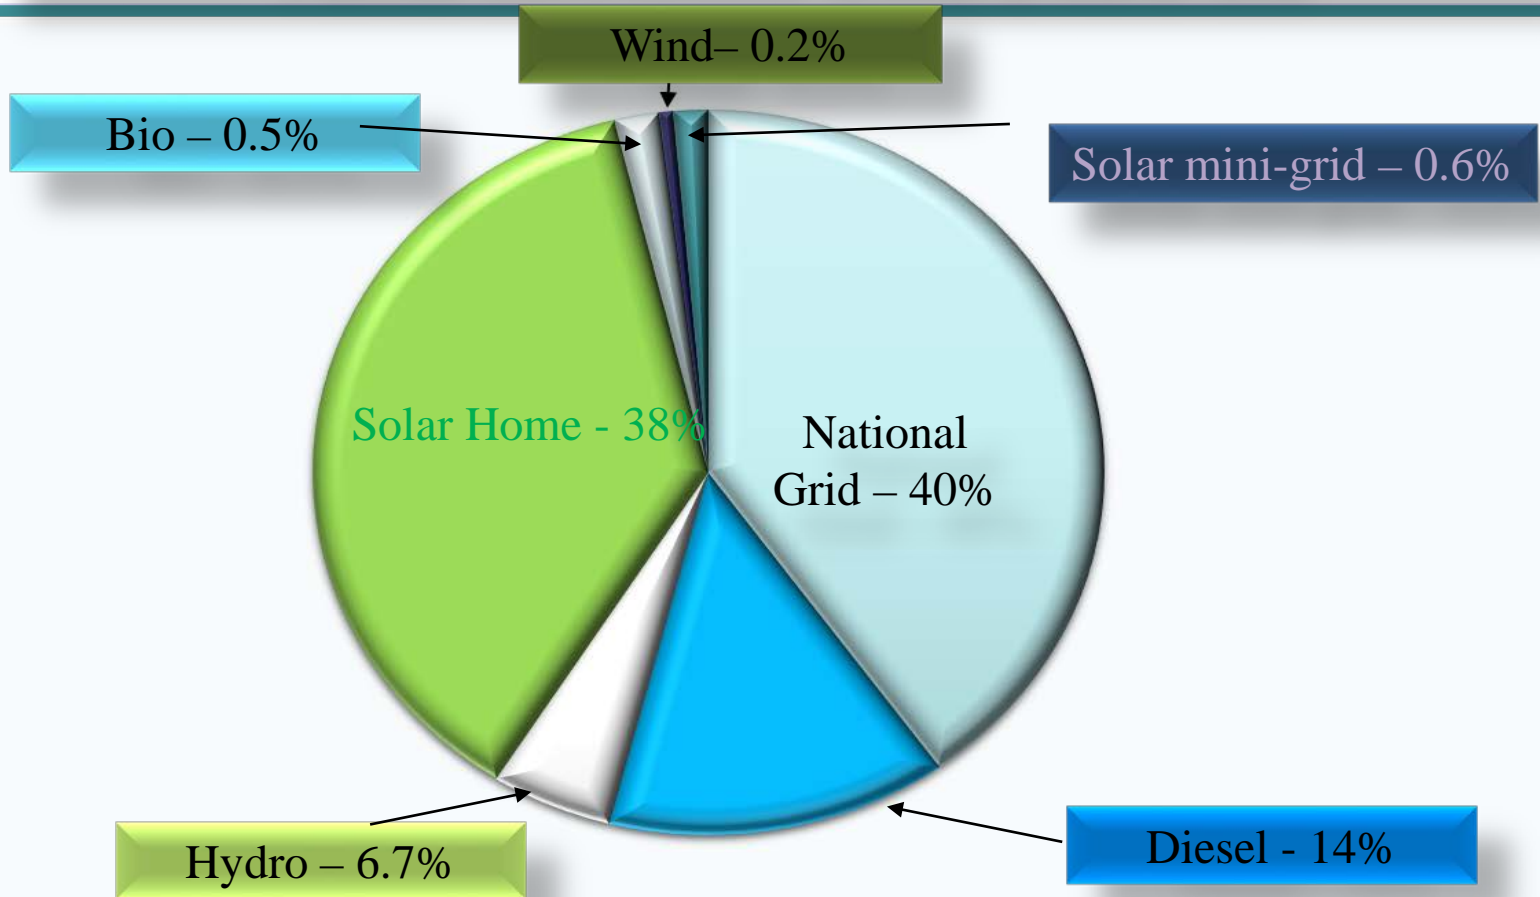

Total Electrification	Grid Line	Diesel	Mini-Hydro	SHS	Mini-Solar	Wind	Bio
20815	8562	2971	1063	7943	134	40	102

Brief of National Energy Policy

- 5.To implement programs on a wider scale, utilizing renewable energy resources
- 6. To promote Energy Efficiency and Energy Conservation
- 7.To establish R, D, D&D (Research, Development, Design and Dissemination) Institution
- 8.To promote international collaboration in energy matters

Research Project for PV Installation Program in UY

19.44kW Grid-Tied PV System

High quality PV system for **electricity cost reduction.**

with

9.6kWh 3Phase Battery System

Li-ion battery system for **emergency power supply.**


- *Objectives:*

- *University of Yangon is famous and leading university in Myanmar.*
- *to supply stable electricity by using renewable energy.*
- *Electricity requirement of our university is about 2 MW.*
- *A pilot project has been launched for installation of 100kW PV system for a basic research and education in University of Yangon.*

- **Process**

- We started a basic data collection of the electricity consumption of the science building from March, 2016 by using power logger PW 3365A, Hioki. Fig.2 shows a typical electricity consumption pattern from June 5 to 11, 2016.
- It is clear that there were black-outs almost once in a day. However, the duration of the black-out was less than 10 minutes. The longest duration of the black-out was 40 minutes at June 6 to June 7.
- The diesel back-up generator (750 kW) has been installed in the power distribution station and it has been operated by manual. Therefore, the black-out of the grid power line could be longer than the observed one.
- Currently the peak electricity consumption does not exceed 50 kW, but it should be larger in the new research building. Therefore 100 kW PV system should be prepared. However, the limitation of the budget, the designed system is targeting only partial equipment, emergency lights which requires about 3 kW.



Electricity consumption in the Science Building of University of Yangon

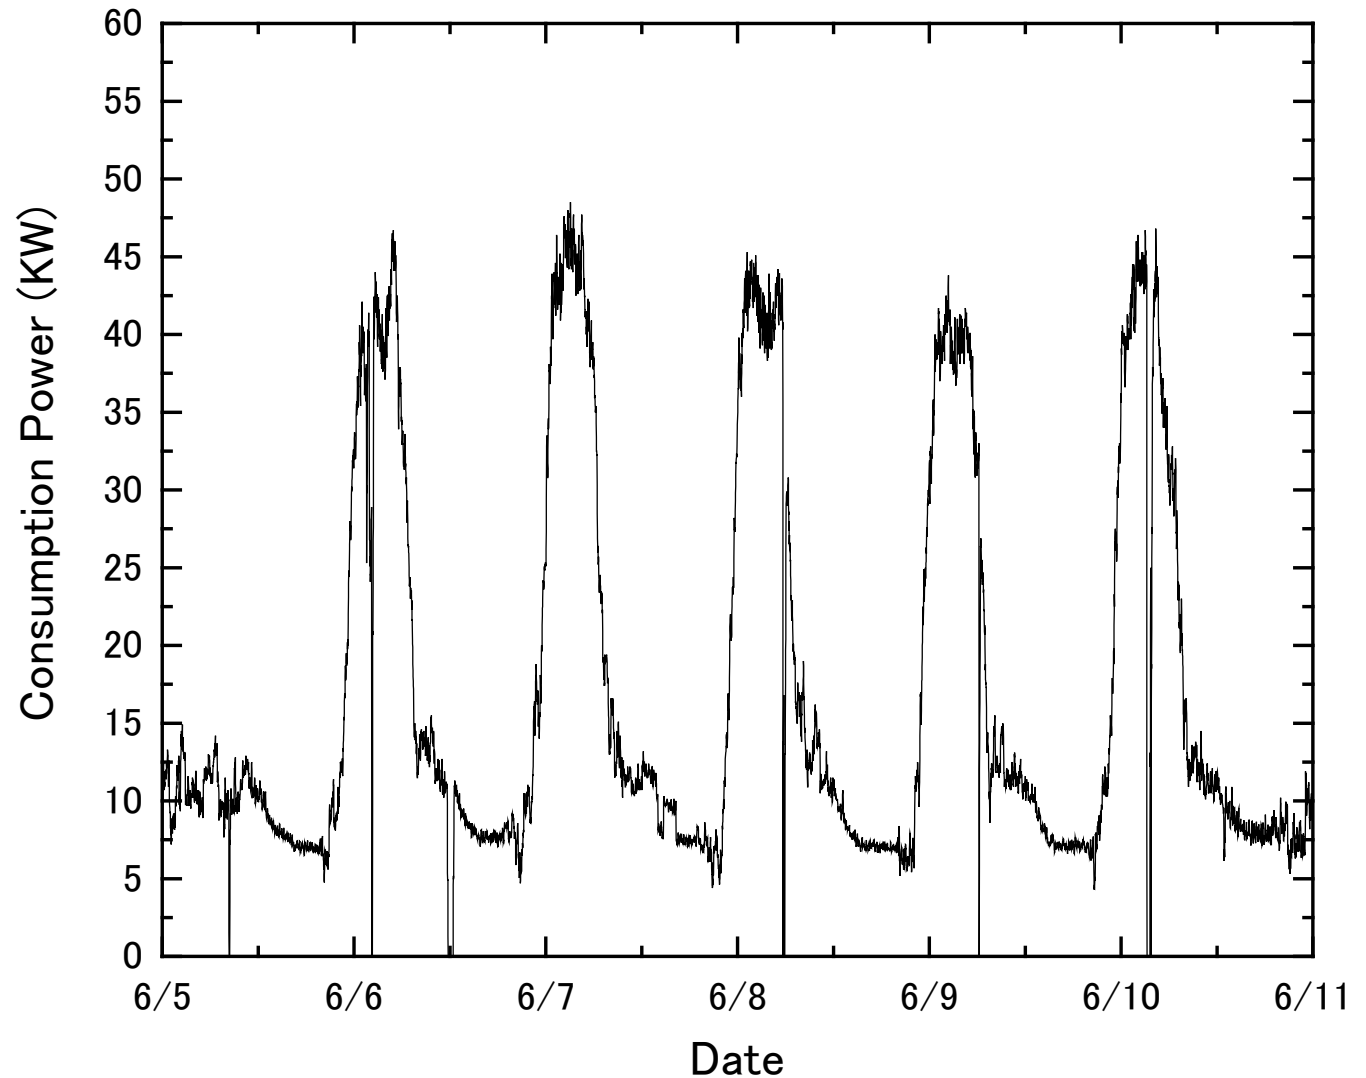

- a typical electricity consumption pattern from June 5 to 11, 2016. It is clear that there were black-outs almost once in a day. However, the duration of the black-out was less than 10 minutes.


PV Capacity : 270W x 72pcs. = **19.44kW**


Storage Battery : Li-ion(LiFePO₄), **9.6kWh**

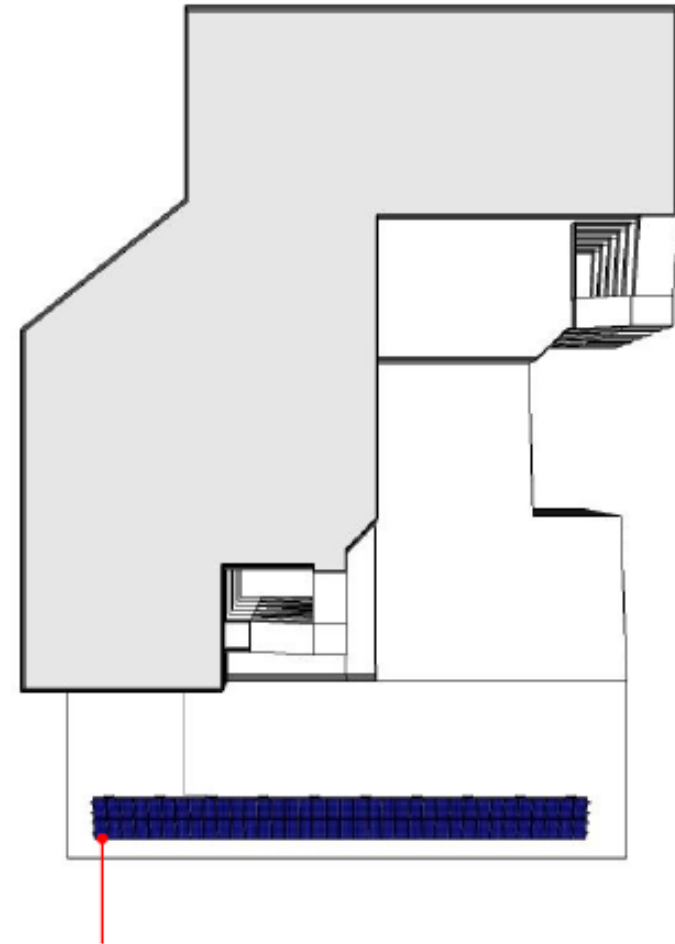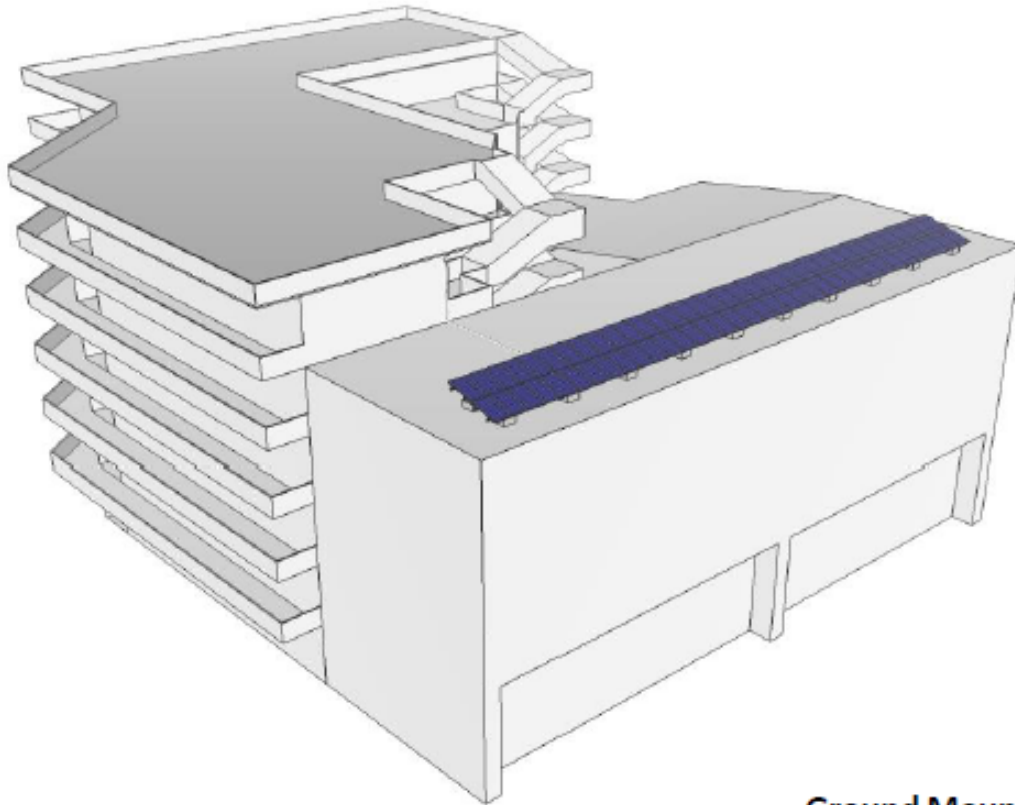



Ground Mounted PV Array, 19.44kW

PV lay out plan for 20 kW module in UY

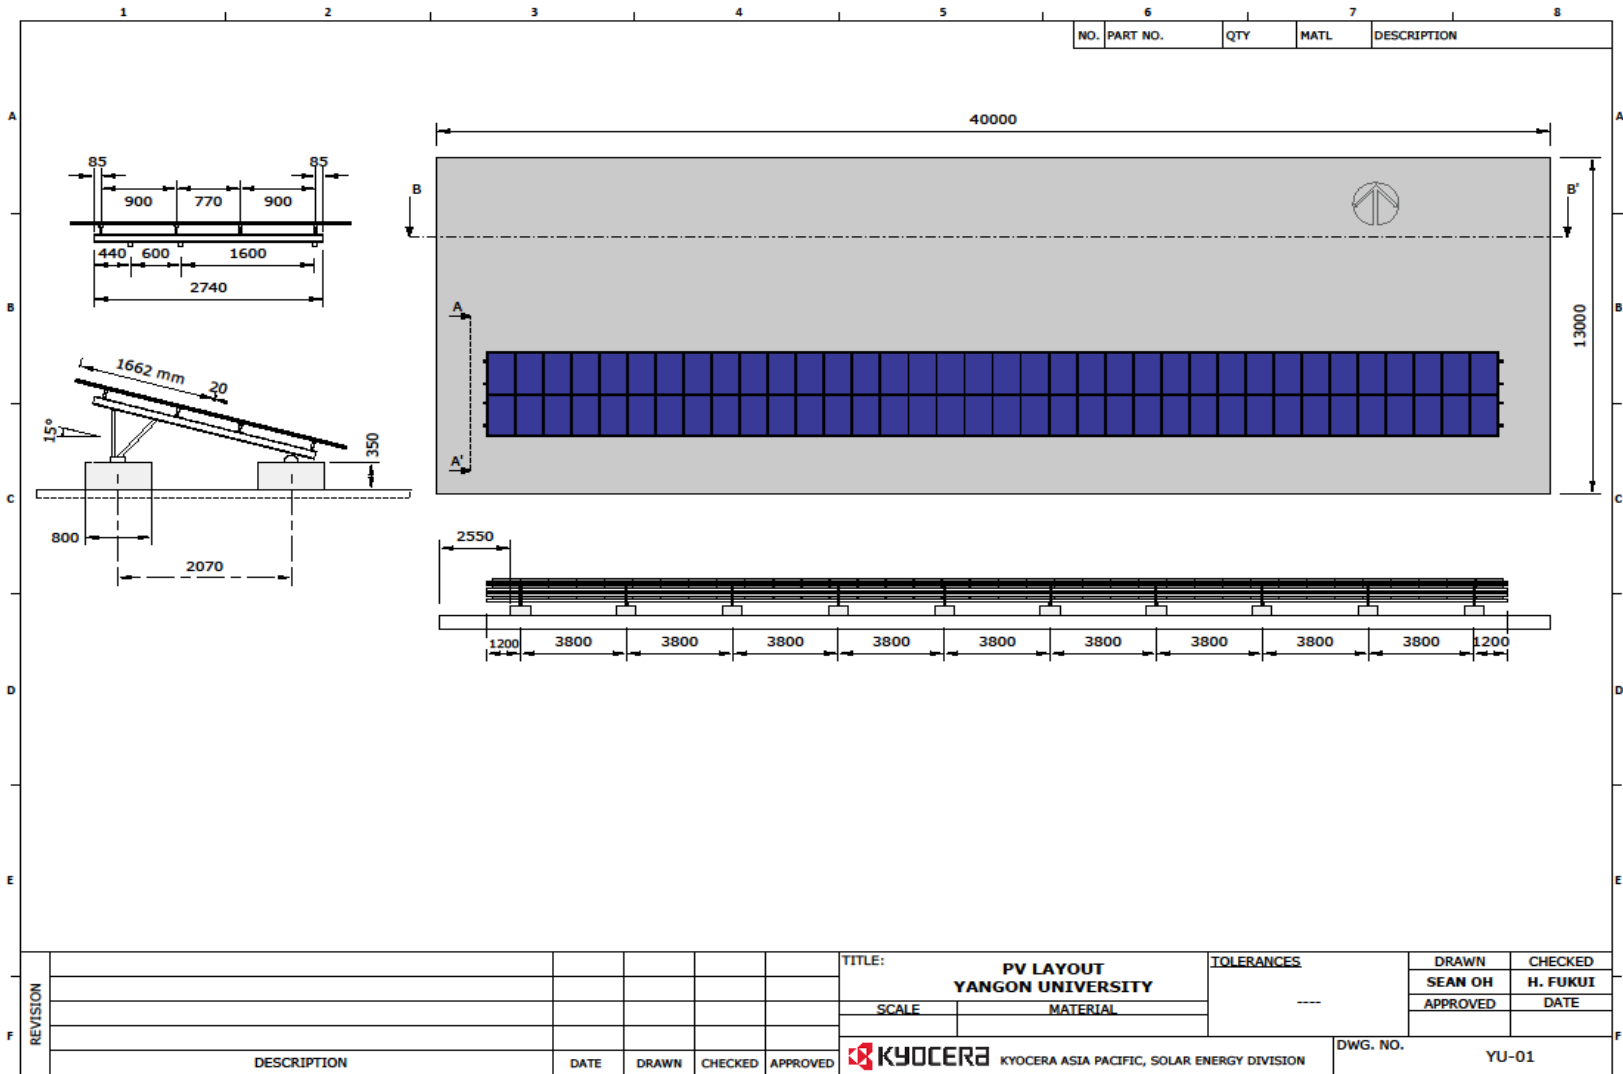

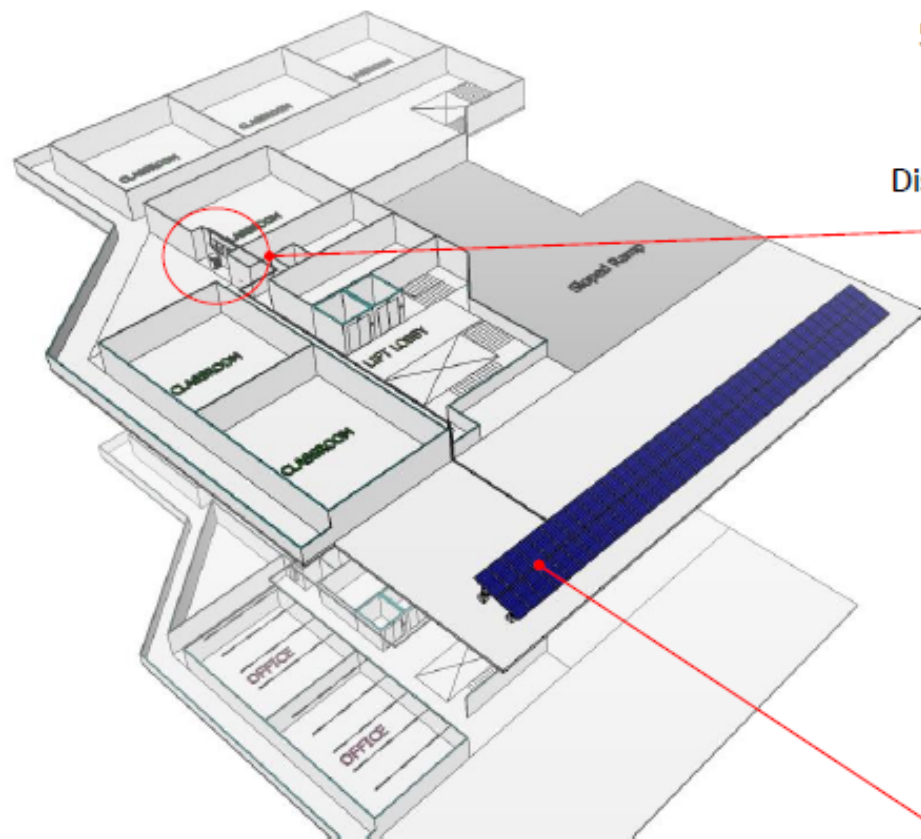


Proposed Layout (6th Floor)

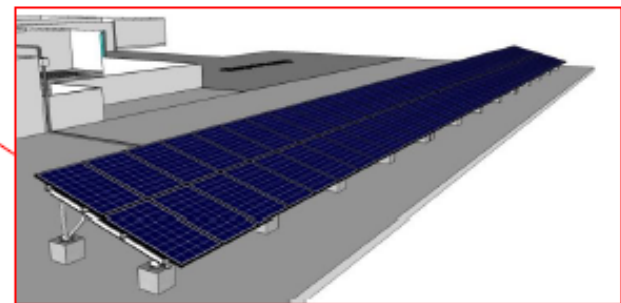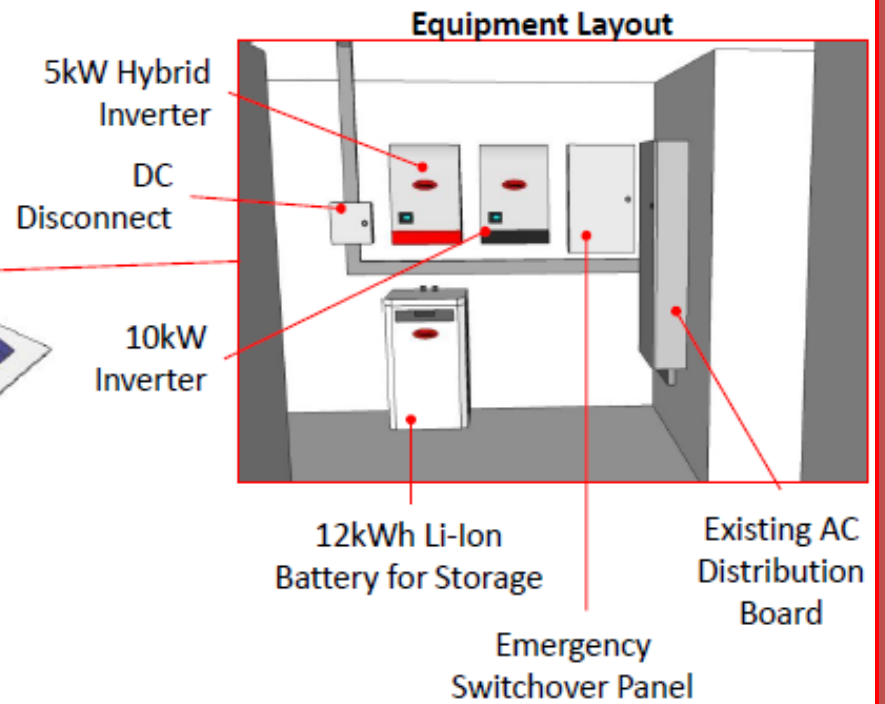


Ground Mounted PV Array, 19.44kW

NO.	PART NO.	QTY	MATL	DESCRIPTION
-----	----------	-----	------	-------------

PLAN VIEW PV EQUIPMENT ROOM

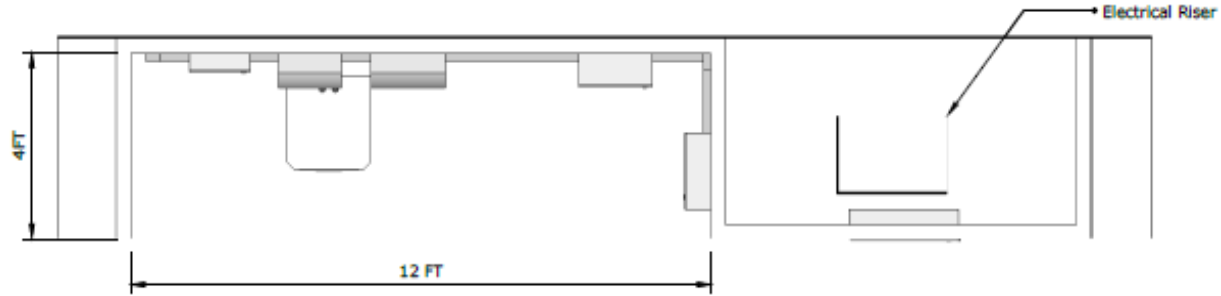

FRONT VIEW PV EQUIPMENT ROOM

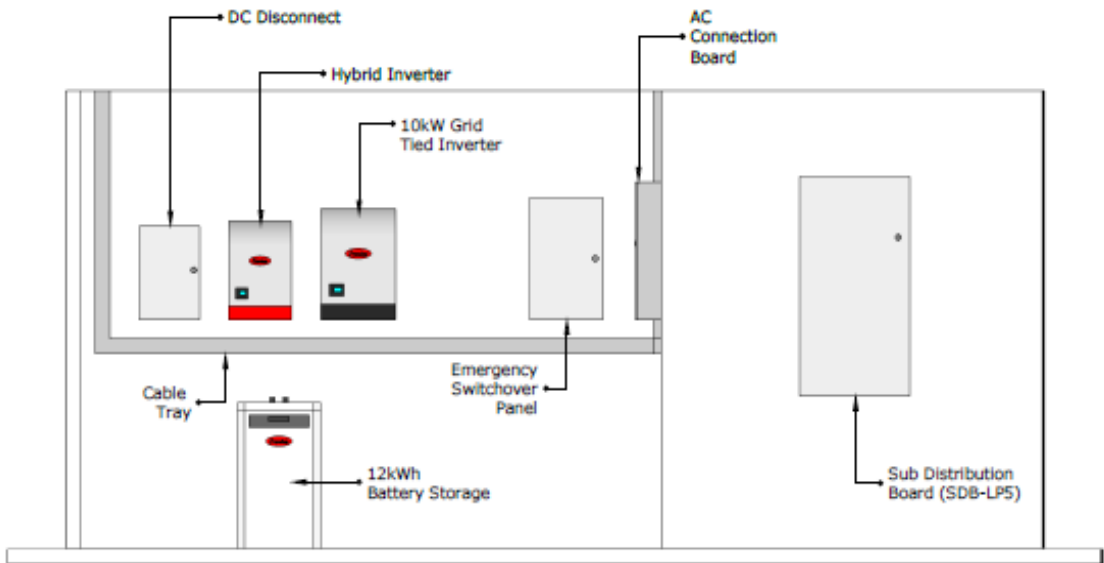


REVISION					
	DESCRIPTION	DATE	DRAWN	CHECKED	APPROVED

TITLE: PV EQUIPMENT LAYOUT YANGON UNIVERSITY	
SCALE: FREE	MATERIAL

TOLERANCES: ****	DRAWN: SEAN OH	CHECKED: H. FUKUI
	APPROVED	DATE

PV system configuration


3-1. System Configuration

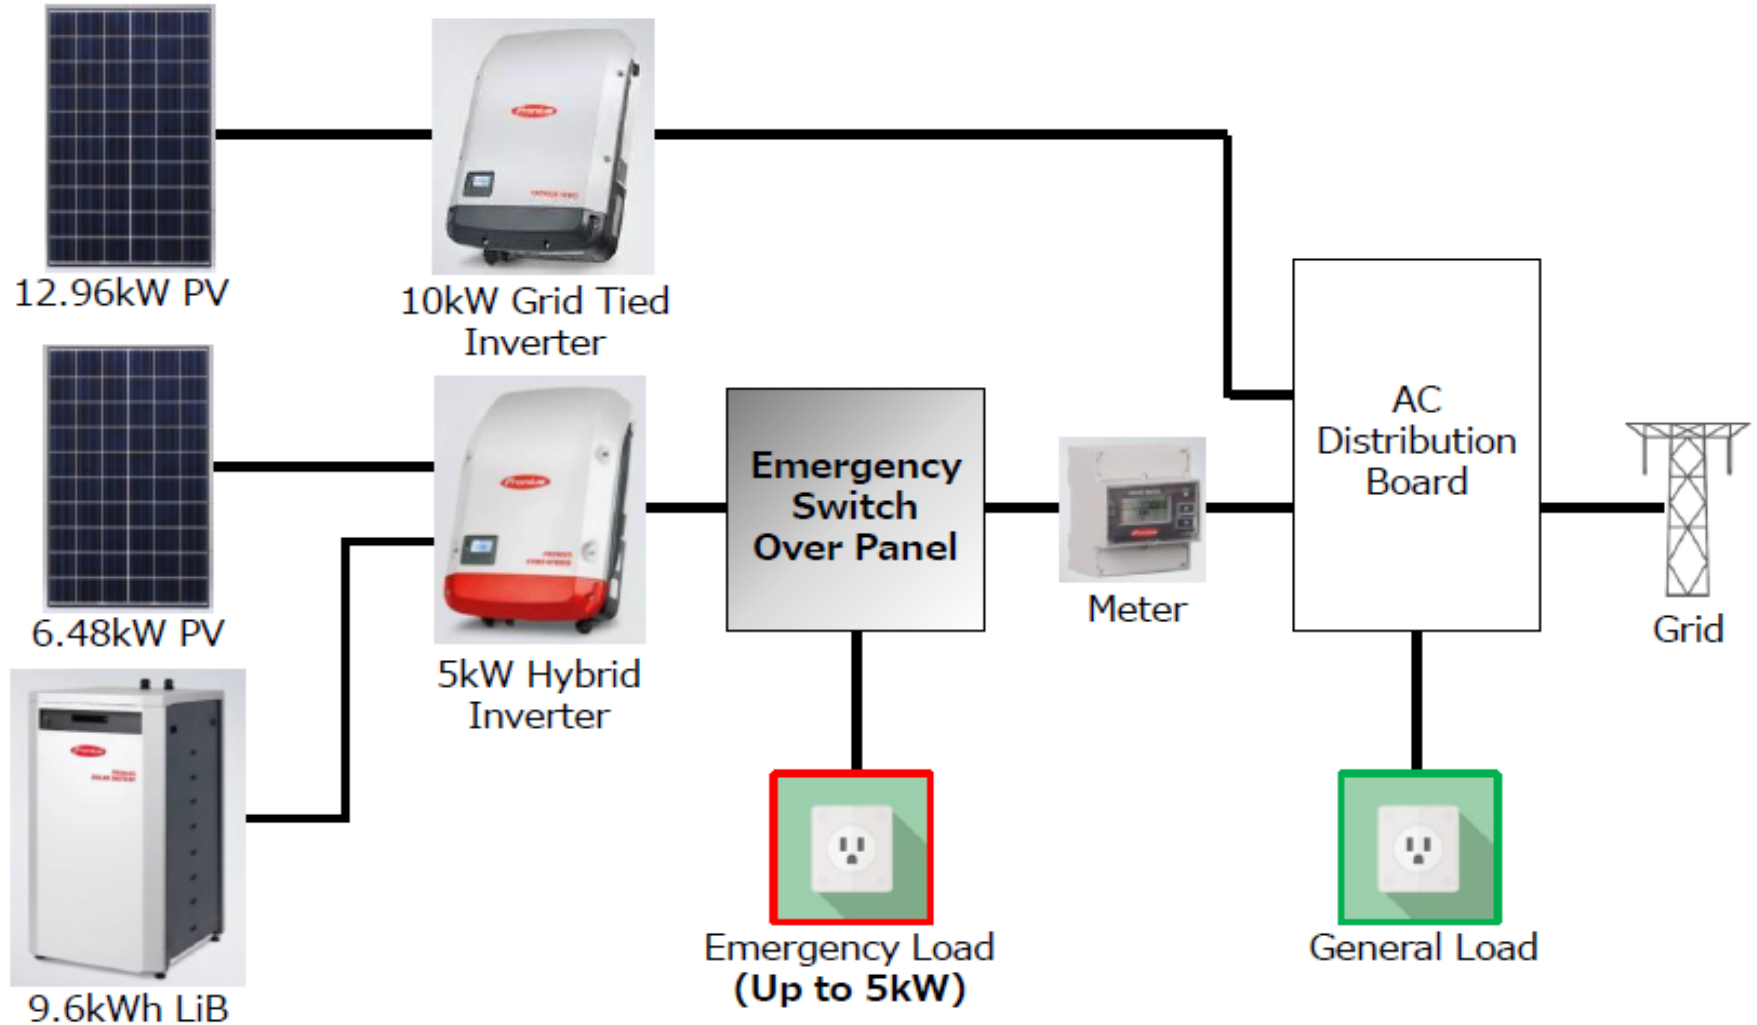

- PV system operation mode in sunny day time

3-2. Operation Mode (Sunny Daytime)


- PV output is supplied to emergency load.
- Surplus PV power is supplied to general load.
- Battery is charged by PV output.

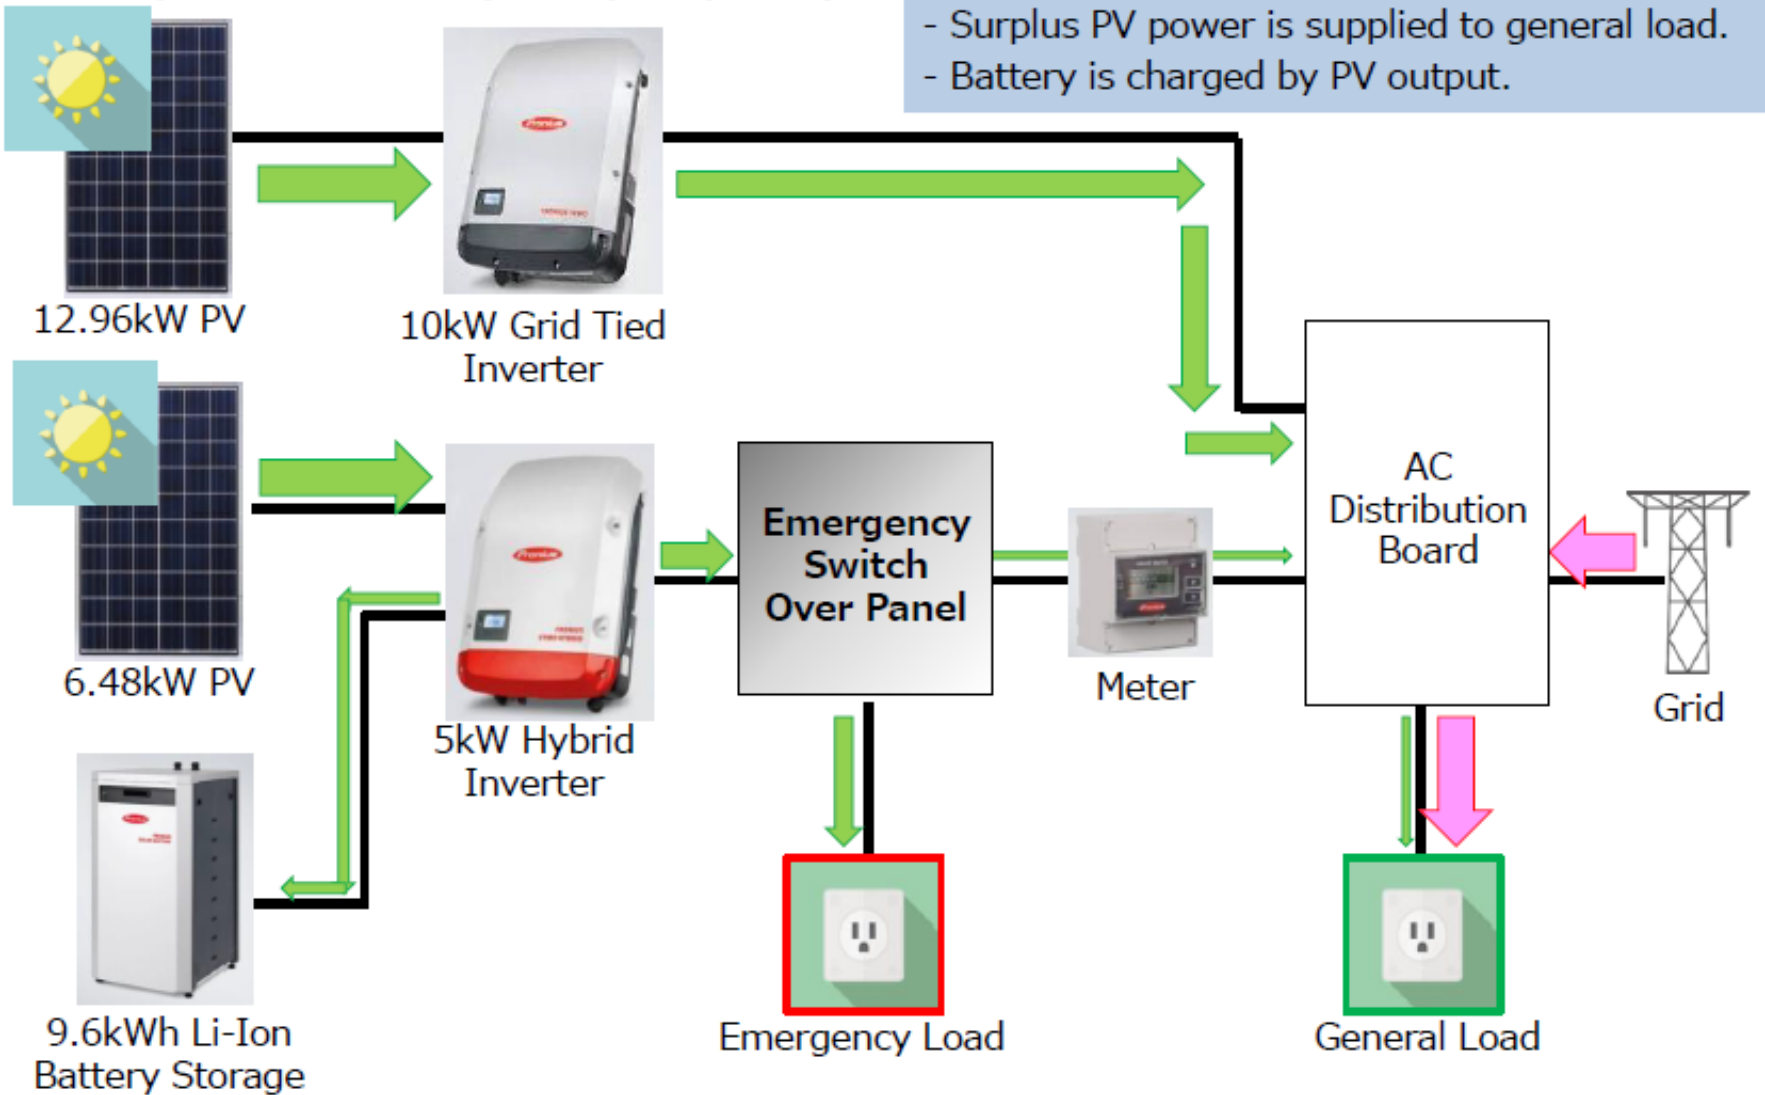

- PV system operation mode in night time

3-3. Operation Mode (Night Time)


- Grid supply power to general load and emergency load.

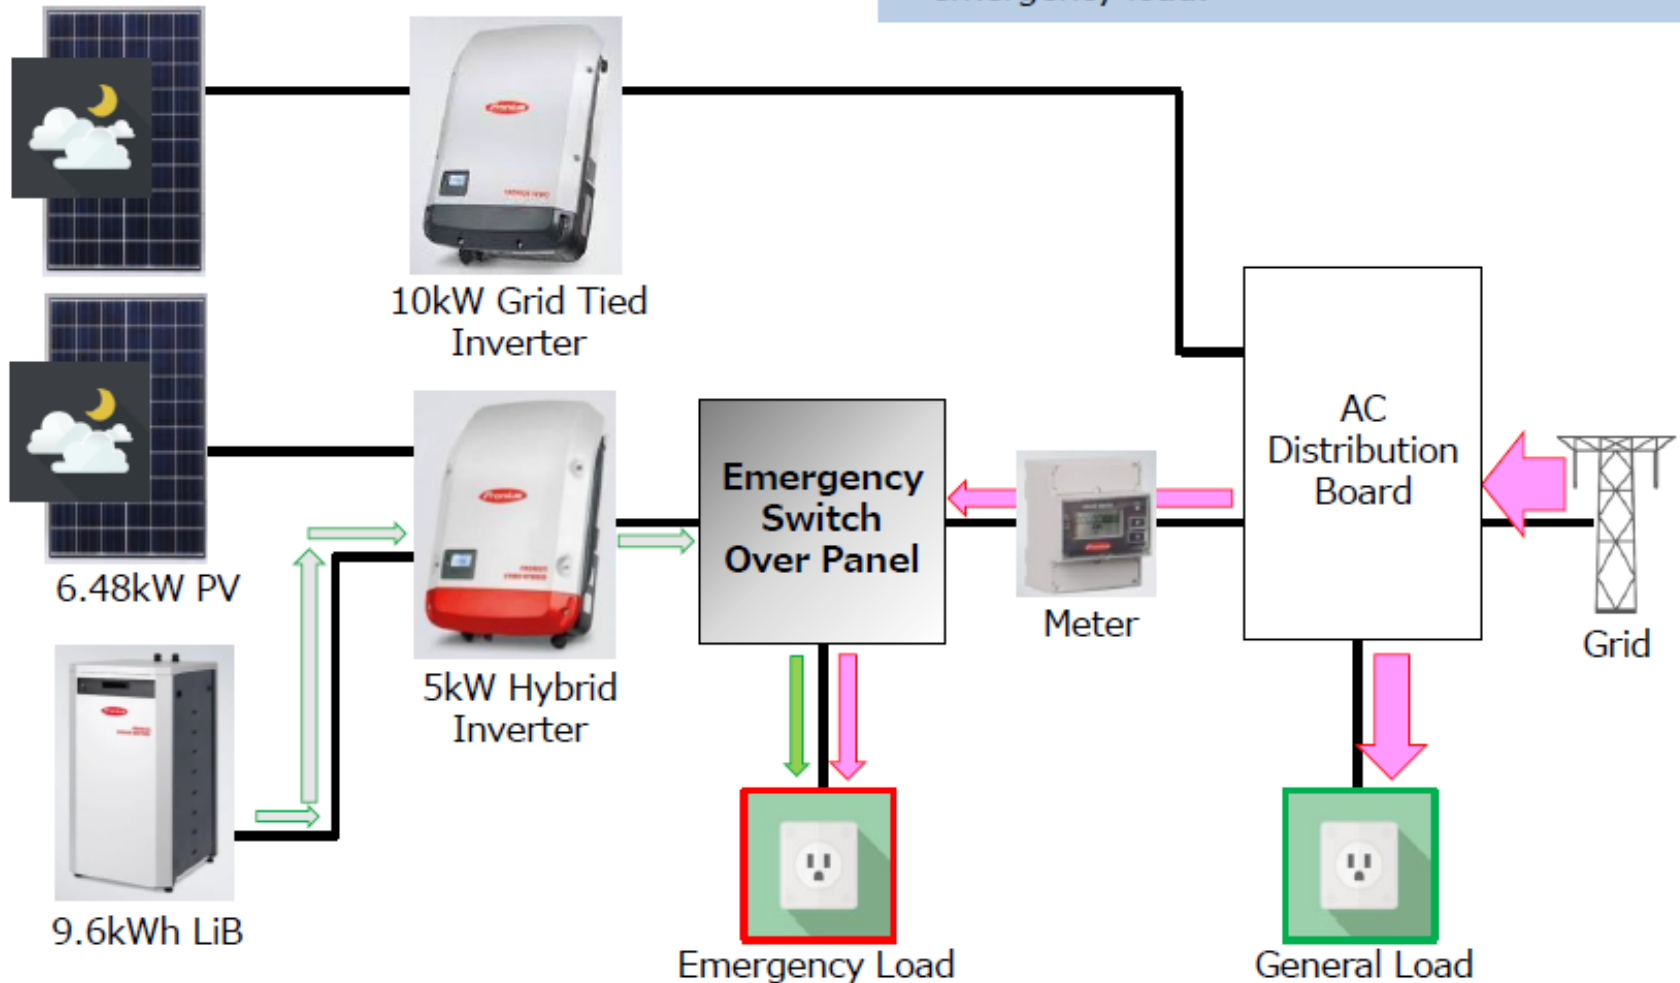


- PV system operation mode in day time with black out condition

3-4. Operation Image (Blackout)

- PV and battery supply power to emergency load. Grid Tied System will stop operation.
- Cannot use general load.

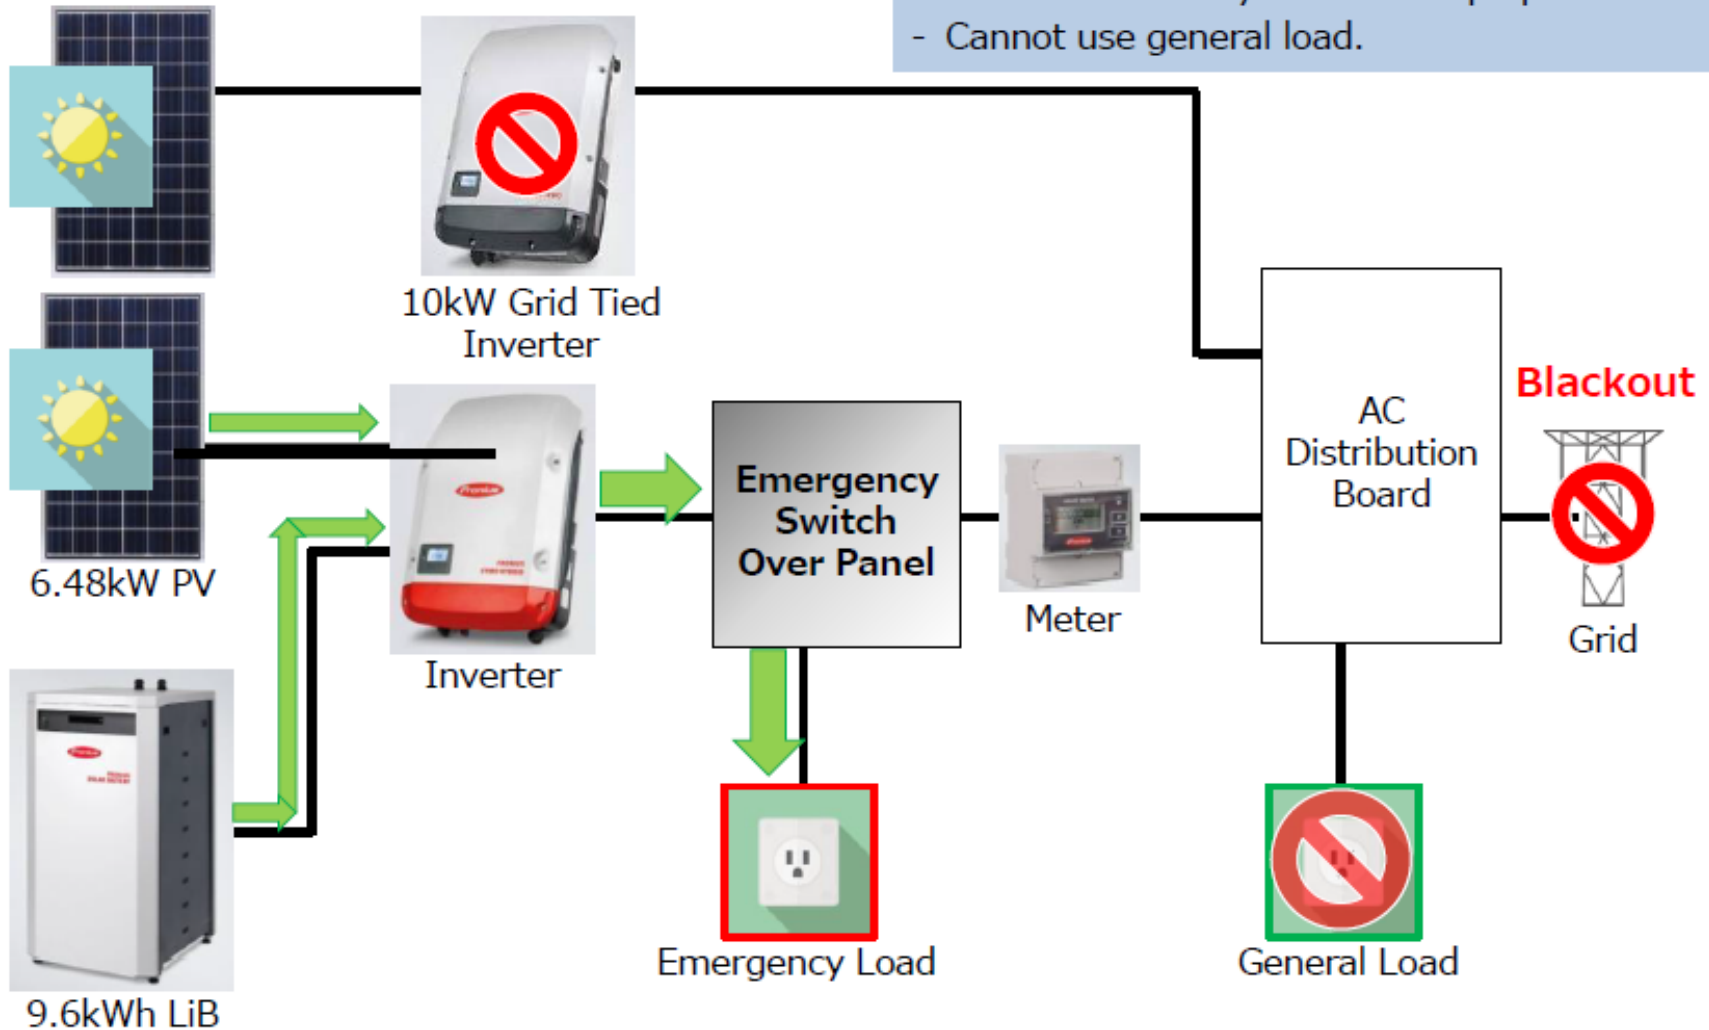


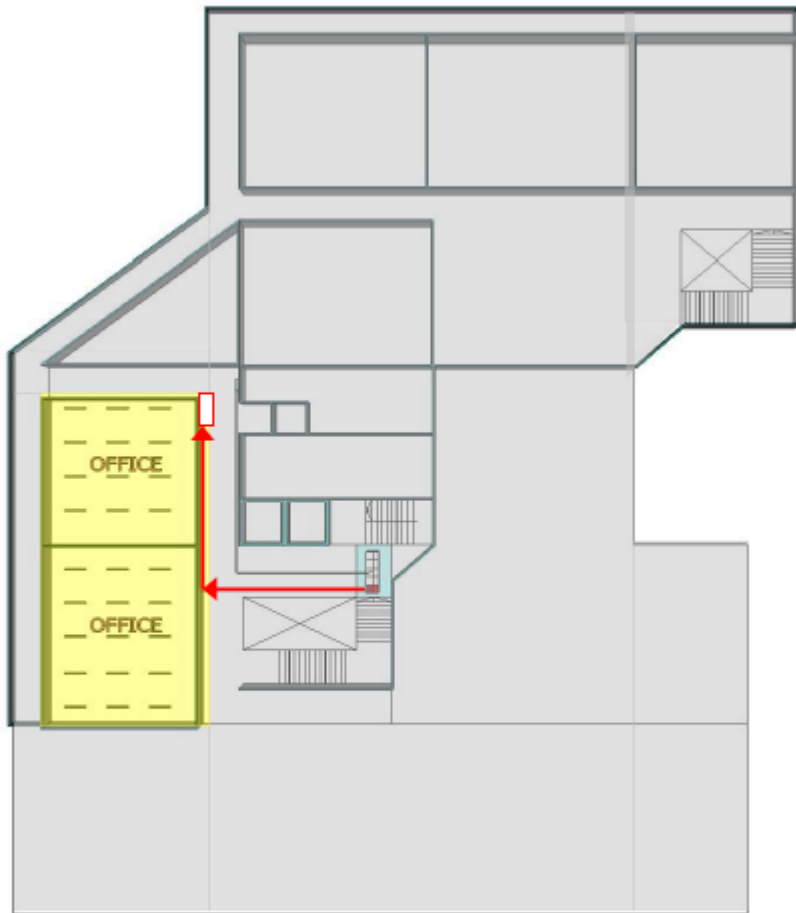

Emergency Lighting Coverage Area
 Non - Emergency Lighting Coverage Area

Emergency Load	Qty	Rating (W)	Total (W)
Lighting Points	60	40	2,400
AC Outlet	6	10	600
Others	NA	NA	NA

Total Demand: 3,000W

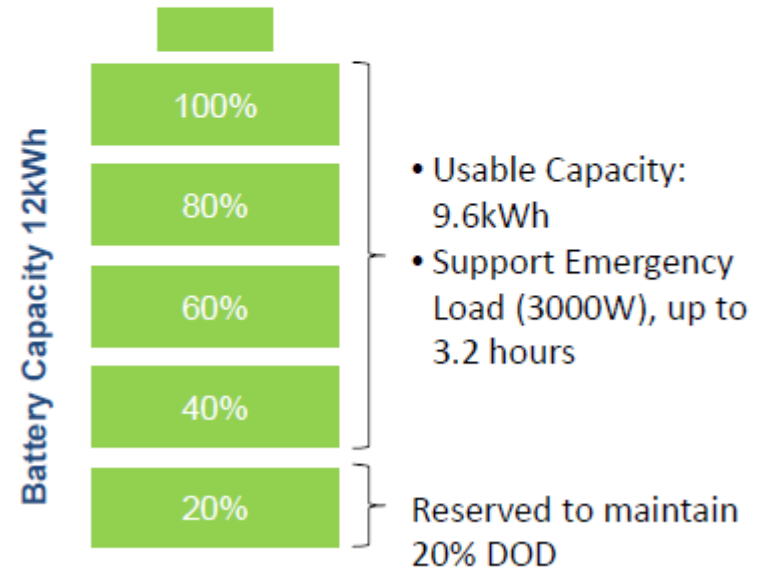



Complete set up of 20 kW PV system in UY




Ribbon cutting ceremony of 20 kW PV system in UY new research building


- Future Plan of UY PV system

Highlights:


- (1) Expansion of existing PV system, installed at 2 locations
 - Level 5 Deck Roof – 72 pcs of 270Wp Solar Modules (19.44kW)
 - Level 6 Deck Roof – 40pcs of 270Wp Solar Modules (10.80kW)
- (2) Solar-Powered High Definition IP Camera Surveillance System
 - HD Camera Surveillance for PV assets (PV Array, Inverters and Battery)
 - Night surveillance with IR Capability
 - Video analytics like motion detection, intrusion detection, etc

Future Expansion without Battery Storage

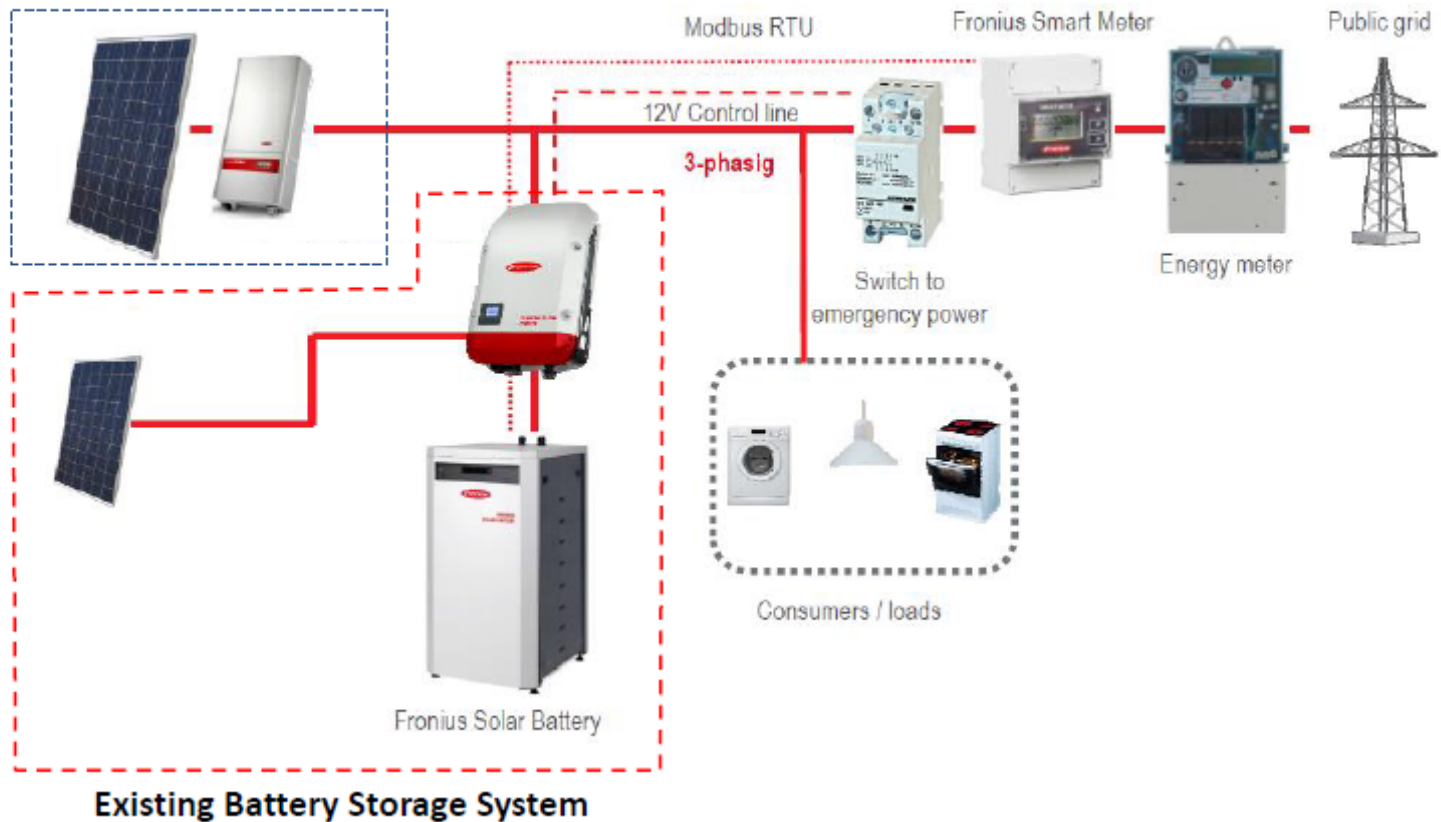

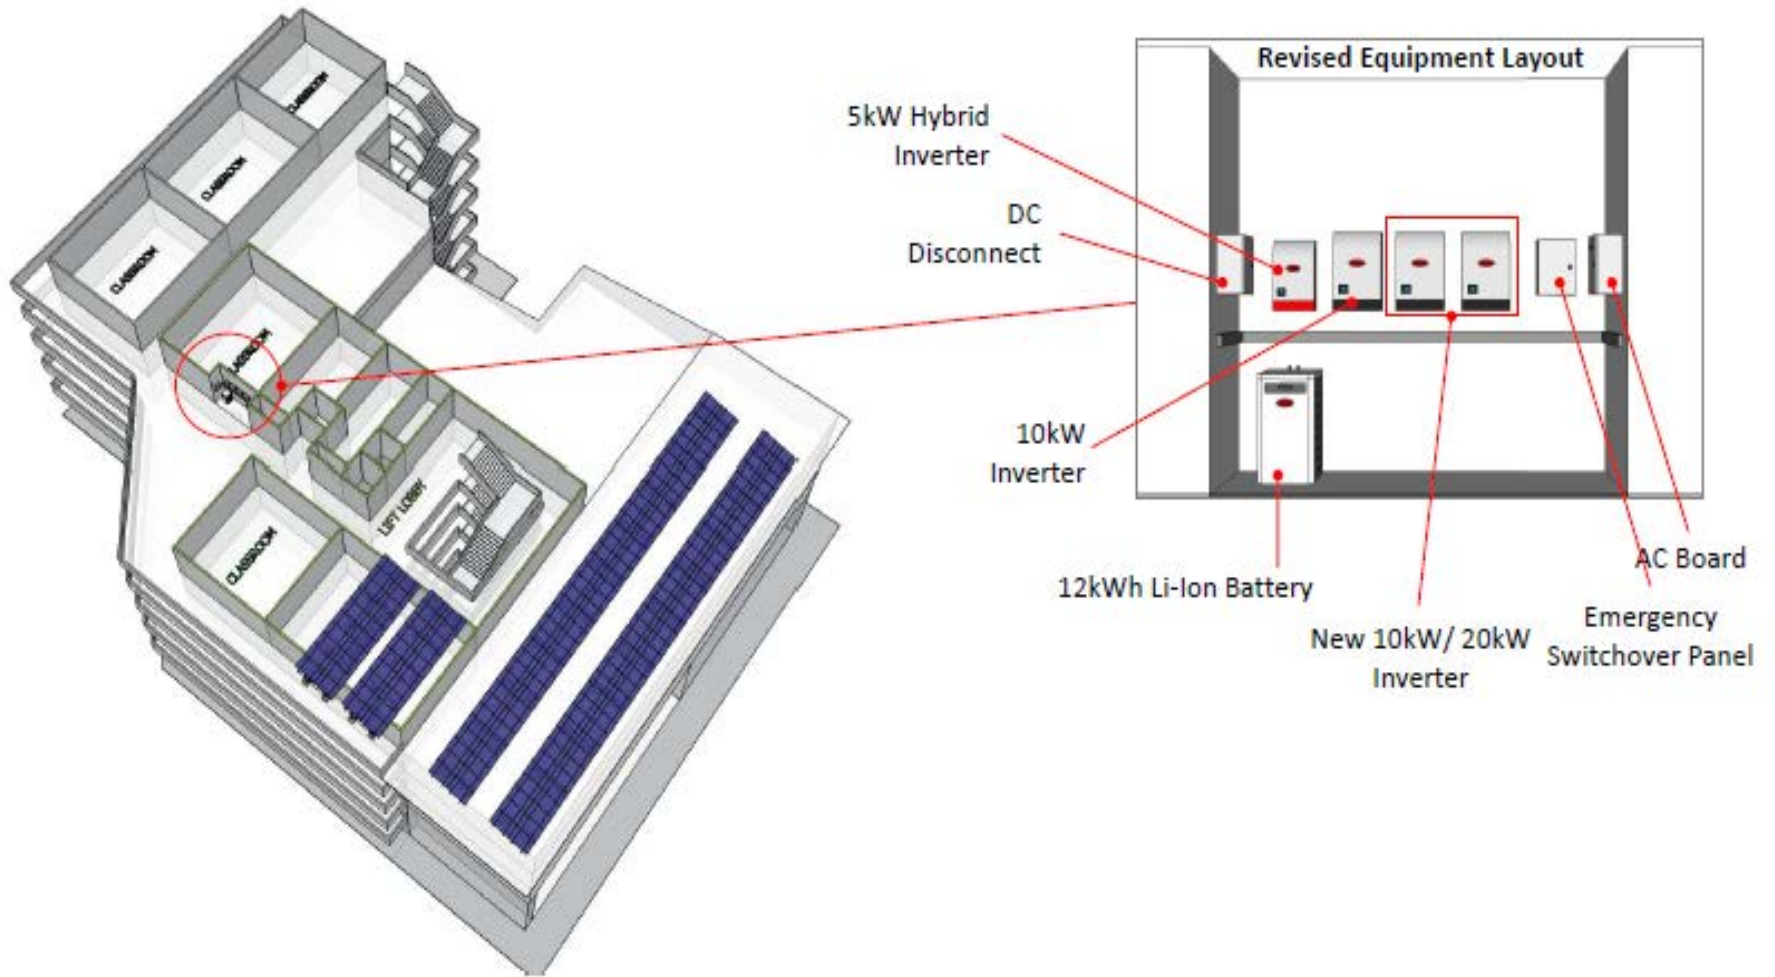


Next phase of 30.24 kW for pilot plan 100 kW

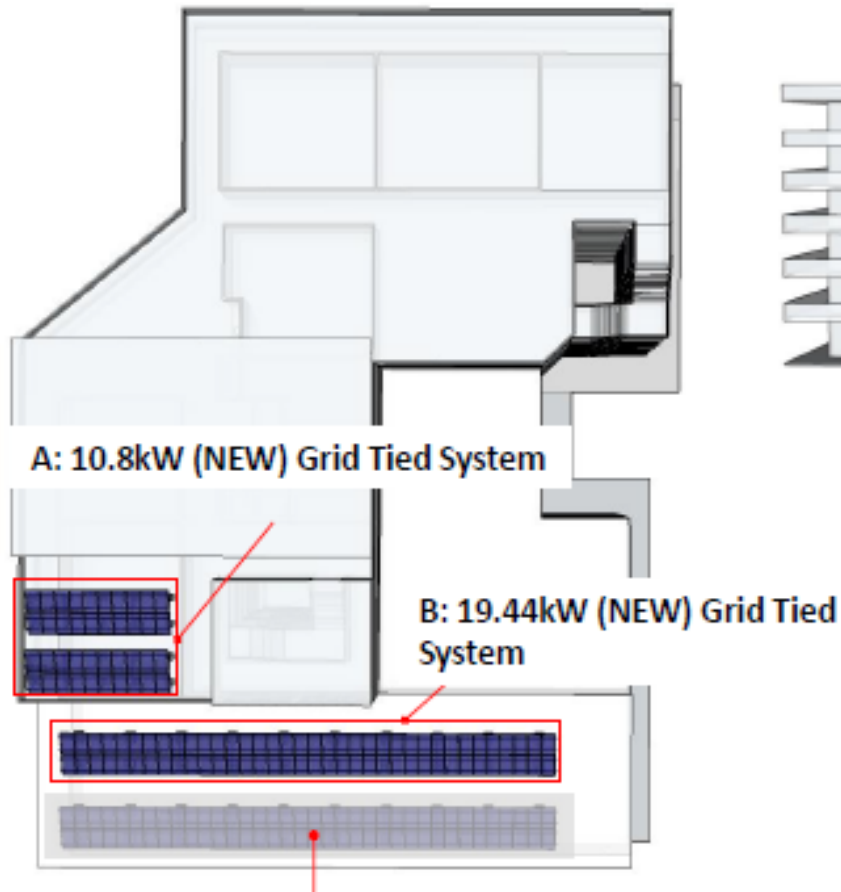

Existing System, 19.44kW

- 12.96kW Grid Tied System
- 6.48kW Hybrid System with Batt Storage

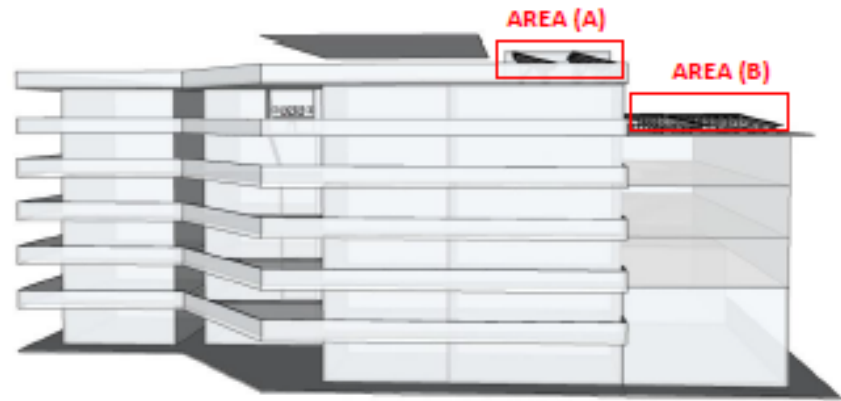

Additional 30.24kWp of Solar Modules to be Installed

(A) Level 6 Roof Area*


- 40 pcs of 270Wp (10.80kW) solar modules is proposed to be installed
- Array structural height will be designed to avoid shading from parapet (1.20m height)

* This area is initially designed with canopy


(B) Level 5 Roof Area

- 72ps of 270Wp (19.44kW) solar modules is proposed to be installed

28/6, 9AM Shading Condition

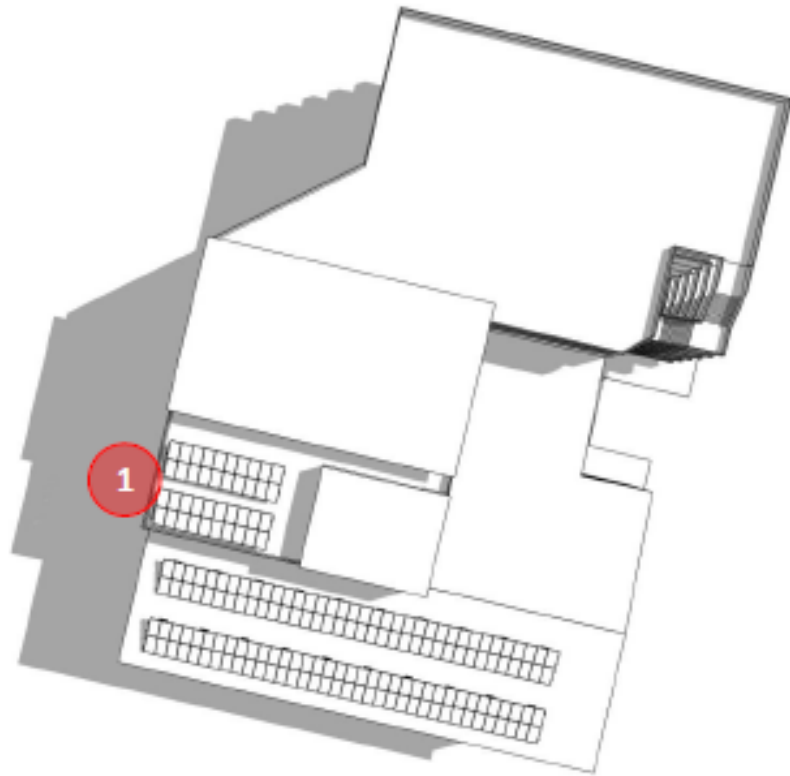


28/6, 3PM Shading Condition

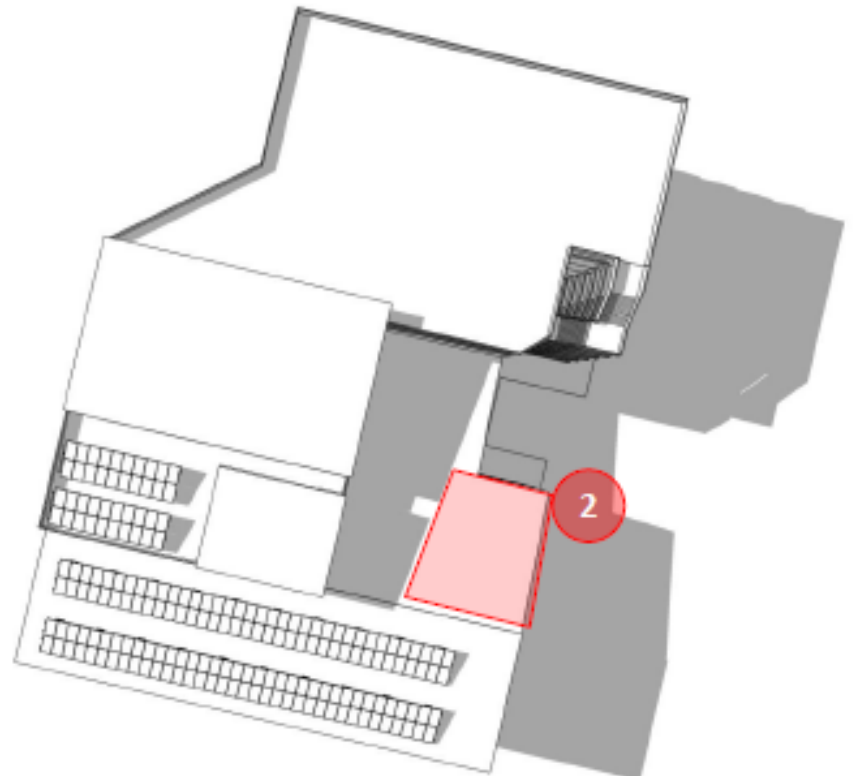

- 1 Structural height for PV Array (Level 6 Roof) is elevated to be of the same height as parapet
- 2 Shading on the ramp is prominent during from 2pm onwards

Estimated Monthly PV Generation, kWh

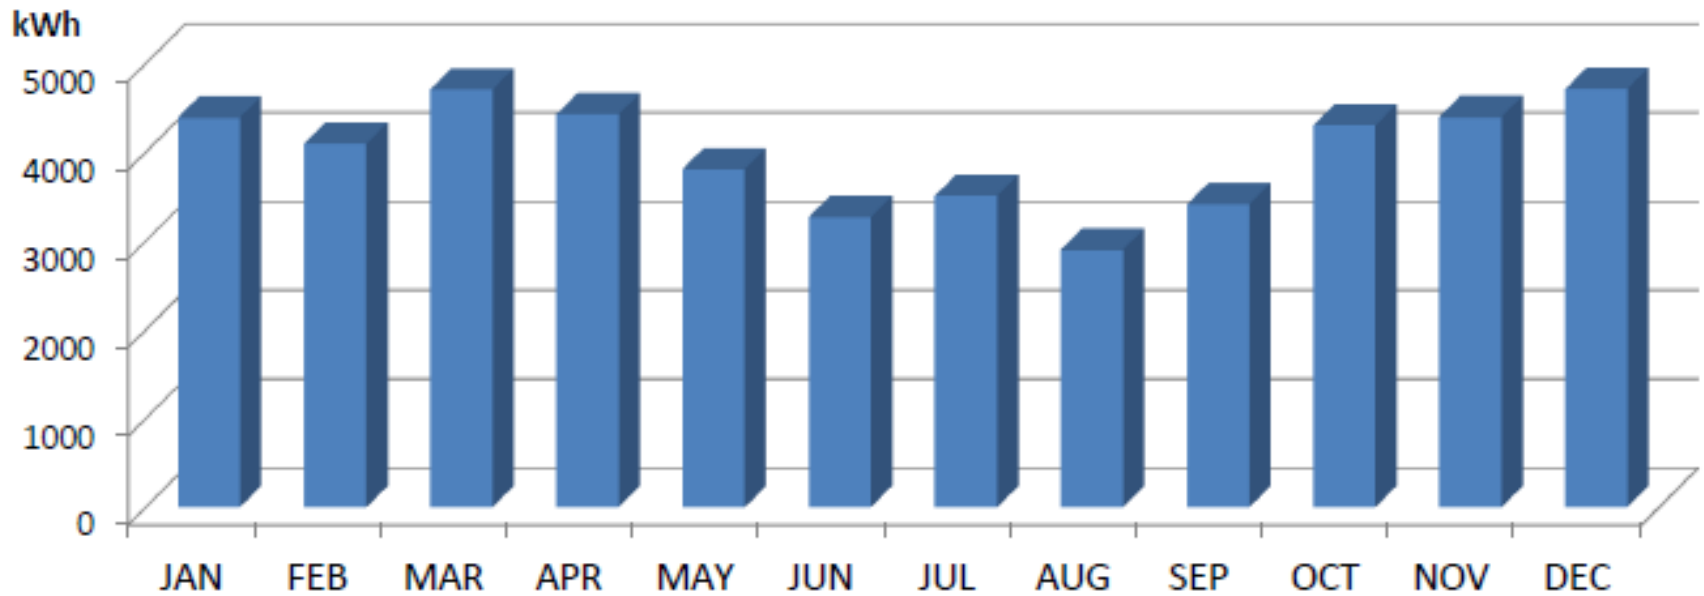

JAN	FEB	MAR	APR	MAY	JUN	JUL	AUG	SEP	OCT	NOV	DEC	Total, kWh
4387	4091	4705	4422	3807	3265	3504	2897	3415	4299	4391	4712	47,895

** Estimates based on PVSYS (V6.2.3) Simulation, only for reference*

- **Conclusion and Future Plan**

- The 20 kW PV system with 10 kWh Li-ion battery storage system has been designed to supply stable electricity in the new research building in University of Yangon. The system installation has been started in October and installation is already finished now. The durability of the Li-ion battery is one of issue in a hot and high humidity condition, although it has been tested in Europe and Japan.
- We found that maximum 50 kW PV system can be set on the current installation place. Therefore, additional 30.24 kW PV system is planning. Finally University of Yangon plans to install a large scale, 2 MW, PV system in near future. The system design and installation place are under considerations. Results should be clear and concise. Quantitative results should be expressed using SI units. Tables and figures should be referred to in the text.

Thank you for your attention